


CK

機図

図面来歴	
記号	内容

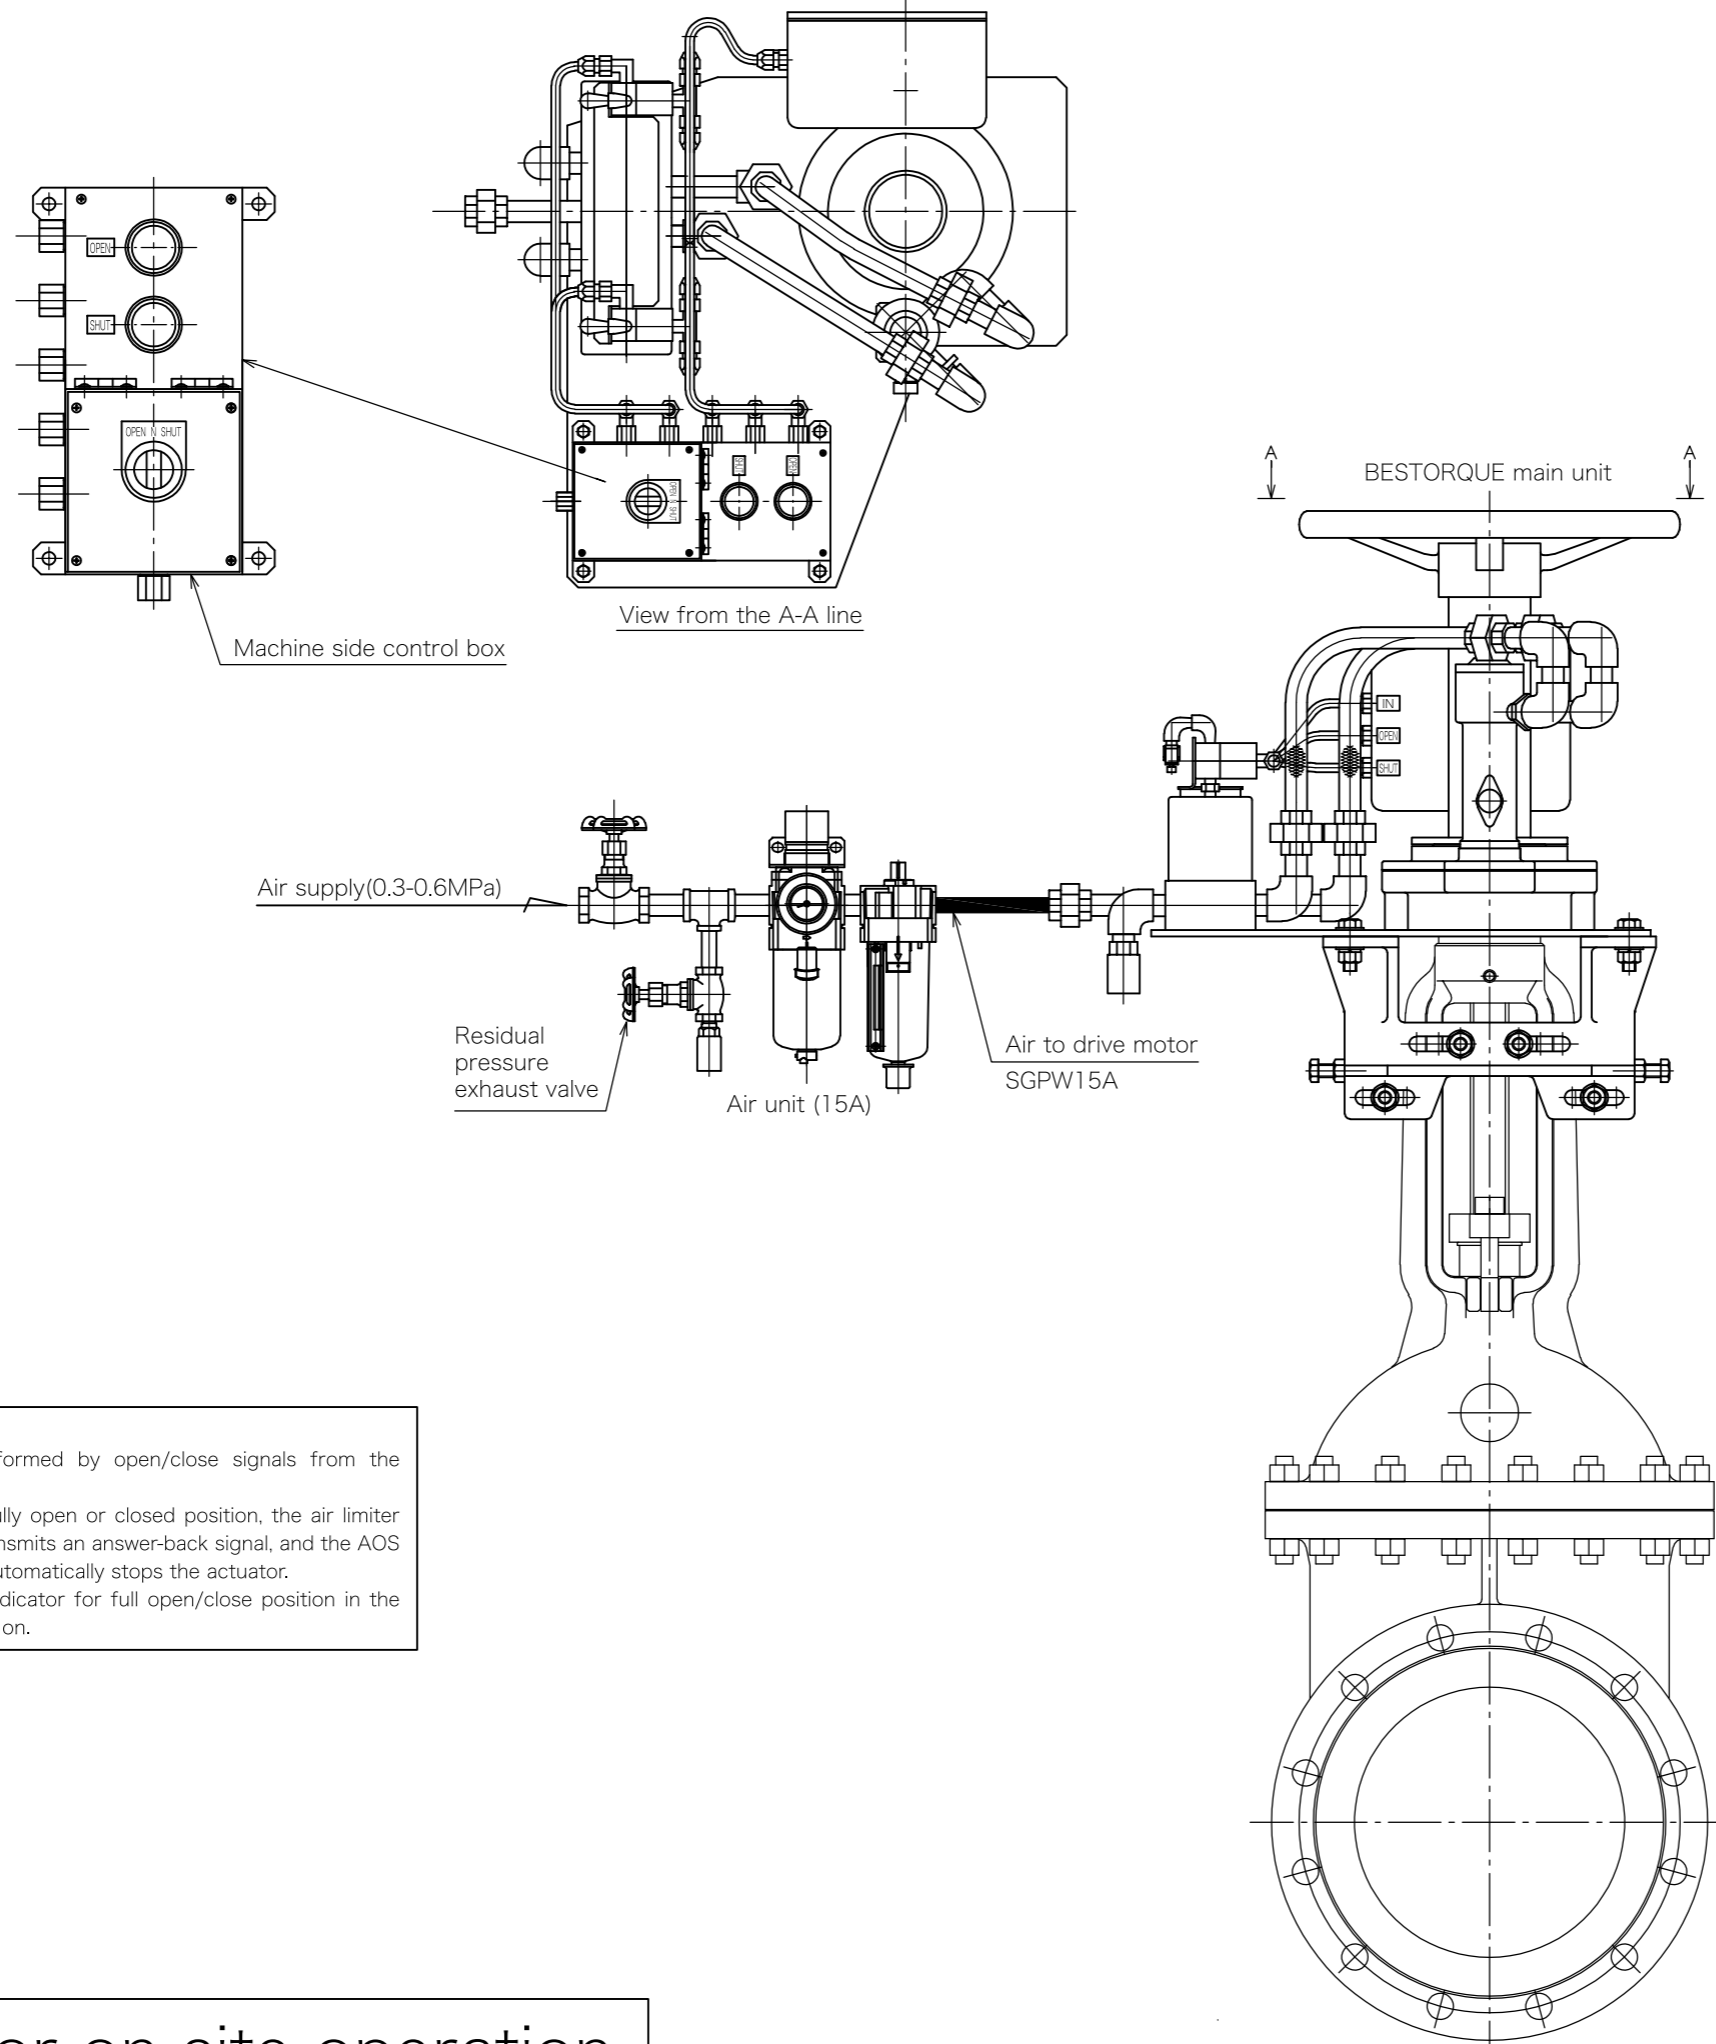

Operational procedure  
 1) Open/close operation is performed by open/close signals from the machine side control box.  
 2) When the valve reaches the fully open or closed position, the air limiter built in Bestorque main unit transmits an answer-back signal, and the AOS unit installed on the actuator automatically stops the actuator.  
 3) Simultaneously, the air lamp indicator for full open/close position in the machine side control box turns on.

TYPE E-1 for on-site operation

機名 機図名	 鋼鉄工業 株式会社		承認	20.11.11	照査	20.11.11	担当	20.11.11	作成	20.11.11
	ベストールク		外番	杉岡	杉岡	上田	上田	尺度	部番	
接続参考図		図番	CK							